

**PROFORMA FOR SAFE DRINKING WATER AND SANITARY
CONDITION CERTIFICATE**

No.....327.....Date: 28/9/2026

It is certified that an inspection team headed by Sanju Kumar, Sub Division Officer, Chas from Drinking Water And Sanitation Division Chas inspected the YMCA International Academy, Telgaria More, Chas, Bokaro on 26/09/2026 (date of inspection) and on the basis of Water Test Report (Attached) bearing no 2026/679 dated 28/09/2026 of District Level Water Testing Laboratory, Chas (PHED Lab) certified that the. YMCA International Academy, Telgaria More, Chas, Bokaro (Name of school) has safe drinking water facilities for the students and members of staff of the institution. School also maintains the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/ State/ U.T. Govt.

This certificate is valid till: One year (01 year i.e upto 27-09-27)

Sanju
28/09/26

Sanju Kumar
Sub Division Officer, Chas
Drinking Water and Sanitation Sub-Division
Chas, Bokaro, Jharkhand-827013

To
Principal
YMCA International Academy,
Telgaria More, Chas
Bokaro, Jharkhand

Note: The certificate is to be issued by authorized officer / PHED Lab / local bodies



District Level Water Testing Laboratory ,Chas
ITI More Chas, PIN-827013
Email: dlwtlchas@gmail.com



TC-16293

TEST REPORT


FIELD: - Testing	DISCIPLINE: - Chemical	GROUP: - Water	SUB GROUP: - Drinking Water
-------------------------	-------------------------------	-----------------------	------------------------------------

Test Report Number: 2026/679	URL No. :TC1629326000000679F	Issue Date: 28/09/2026
Issued To: (Name & Address of Customer)	YMCA International Academy Telgaria More, Chas Bokaro, Jharkhand	Source Type – Ground Water
		Sample Id.: DLWTLCHAS/2026/GW/679
		Sample Received Date: 26/09/2026
Date of Start Analysis:	26/09/2026	Sample Collected By: Sample Taker
Date of Completion Analysis:	28/09/2026	Sample Quantity: - 1 litter
		Sample Condition: - Good

Sl. No.	Parameter	Unit	Result	Method Reference	Specification as per BIS – 10500:2012 (Second Revision) Amendment – June 2015	
					Acceptable Limit	Permissible Limit (In Absence of Alternate source)
1	pH	-	7.51	APHA 24 th Edition 2023-4500-H ⁺ B, (Electrometric Method)	6.5 – 8.5	No relaxation
2	Turbidity	NTU	3.02	APHA-24 th Edition 2023-2130-B, (Nephelometric method)	1	5
3	Total Dissolved Solids	mg/L	208	APHA 24 th Edition .2023-2540 C, (Total Dissolved Solids Dried at 180°C)	500	2000
4	Total Alkalinity as CaCO ₃	mg/L	56	APHA-24 th Edition 2023-2320-B, (Titration Method)	200	600
5	Total Hardness as CaCO ₃	mg/L	144	APHA-24 th Edition 2023-2340-C (EDTA Titrimetric method)	200	600
6	Calcium as Ca	mg/L	40.08	APHA-24 th Edition 2023-3500-Ca-B, (EDTA Titrimetric Method)	75	200
7	Magnesium as Mg	mg/L	10.69	APHA-24 th Edition 2023-3500-Mg-B, (Calculation Method)	30	100
8	Chloride as Cl	mg/L	55.98	APHA-24 th Edition 2023-4500 Cl- B, (Argentometric method)	250	1000
9	Fluoride as F	mg/L	0.59	APHA-24 th Edition 2023-4500 F ⁻ C, (Ion selective electrode method)	1.0	1.50
10	Colour	HU	05	APHA-24 th Edition 2023-2120 B, (Visual Comparison)	5	15
11	Odour	-	Agreeable	IS 3025 (Part5): 2022, Observation	Agreeable	Agreeable
12	Taste	-	Agreeable	IS 3025 (Part 8):2023, Observation	Agreeable	Agreeable

Notes: -

- ♦ The results listed refer only to the tested sample and applicable parameters as received from the customer
- ♦ This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- ♦ This report cannot be reproduced, except when in full, without the written permission of the Lab In-charge.
- ♦ All disputes are subjected to the Bokaro Jurisdiction.
- ♦ BDL=Below Detection Limit.
- ♦ The laboratory is responsible for all the information given in the report.

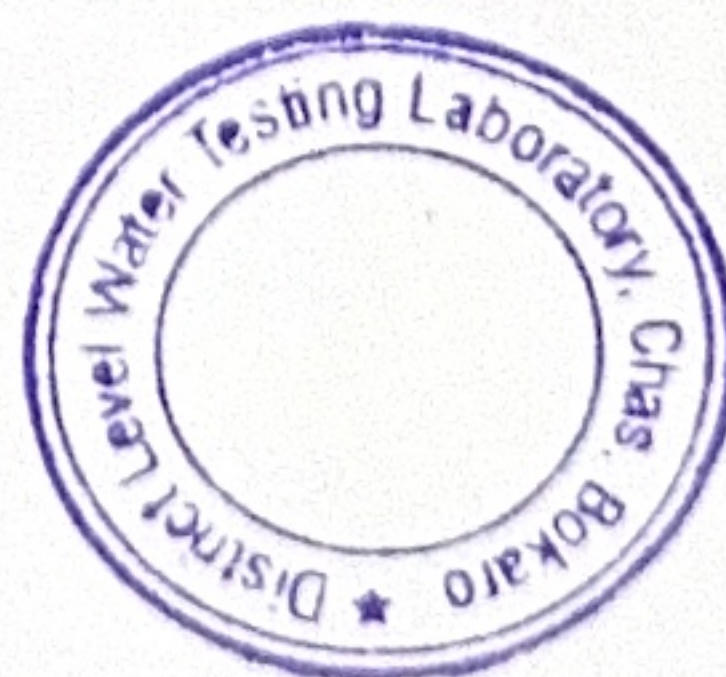

Reviewed & Authorized By:

Mukul Rawani
28/09/26

Quality Manager
District Level Water Testing Laboratory
D.W. & S. Division, Chas

(Mukul Rawani)

End of Report

Quality Manager



District Level Water Testing Laboratory ,Chas
ITI More Chas, PIN-827013
Email: dlwtlchas@gmail.com

TEST REPORT

FIELD: - Testing	DISCIPLINE: - Biological	GROUP: - Water	SUB GROUP: - Drinking Water
-------------------------	---------------------------------	-----------------------	------------------------------------

Test Report Number: 2026/679	URL No. :-----	Issue Date: 28/09/2026
Issued To: (Name & Address of Customer)	YMCA International Academy Telgaria More, Chas Bokaro, Jharkhand	Source Type –Ground Water
		Sample Id.: DLWTLCHAS/2026/GW/679
		Sample Received Date: 26/09/2026
Date of Start Analysis:	26/09/2026	Sample Collected By: Sample Taker
Date of Completion Analysis:	28/09/2026	Sample Quantity: - 1 liter
		Sample Condition: - Good

Sl. No.	Test Parameter	Unit	Result	Method Reference	Specification as per BIS – 10500:2012 (Second Revision) Amendment – June 2015	
					Acceptable Limit	Permissible Limit (In Absence of Alternate source)
1	Total Coliform	CFU/100 mL	< 1	APHA 24 th Ed. 2023-9222 B (Membrane Filter Technique)	Shall not be detected in any 100 mL Sample	
2	Thermotolerant (Faecal) Coliform	CFU/100 mL	< 1	APHA 24 th Ed. 2023-9222 D (Membrane Filter Technique)	Shall not be detected in any 100 mL Sample	

Specific Contractual Notes :-

- ◆ The results listed refer only to the tested sample and applicable parameters as received from the customer
- ◆ This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- ◆ Tested Sample shall be retained up to seven days from the date of issue of the certificate.
- ◆ This report cannot be reproduced, except when in full, without the written permission of the Lab In-charge.
- ◆ All disputes are subjected to the Bokaro Jurisdiction.
- ◆ Customer asked for above test only.
- ◆ < 1 Indicates the absence of Bacteria
- ◆ TNTC = Too Numerous To Count



Reviewed & Authorized By:

Mukul Rawani
28/09/26

Quality Manager
District Level Water Testing Laboratory
D.W. & S. Division, Chas
(Mukul Rawani)
Quality Manager